

Bear Creek Township

WATER METER REMOTE READER

The remote reading device for the water meter reading shall be mounted on the exterior of the building at a readily accessible location. Mounting height shall be 3 to 5 foot above finish grade.




3' TO 5'




INSTALLATION OF MULTIPLE METERS AND REMOTES

Buildings with two or more water meters shall have the remote meter readers labeled indicating which remote reads the corresponding water meter.

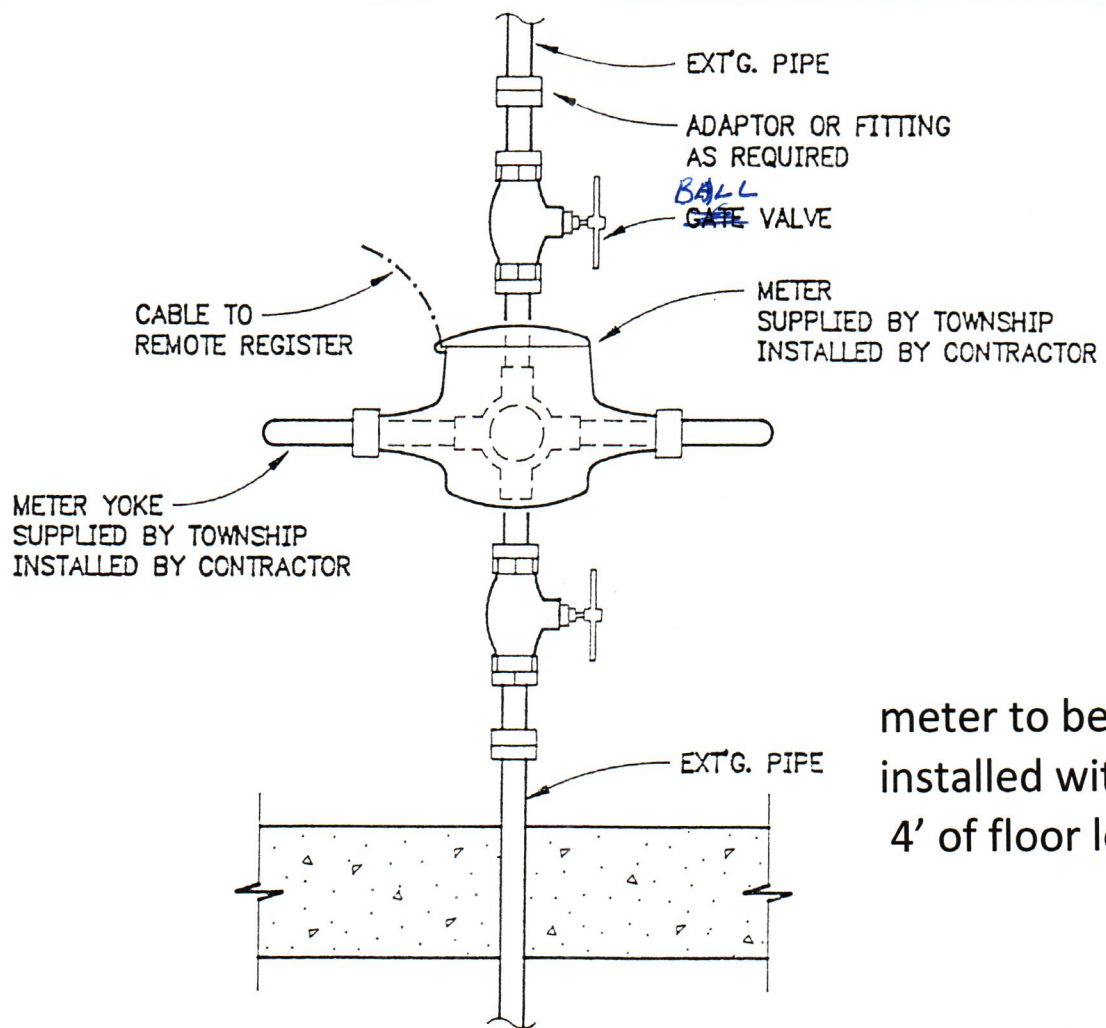

meter to be installed within 4' of floor level

TYPICAL METER INSTALLATION
METER YOKE SETTING

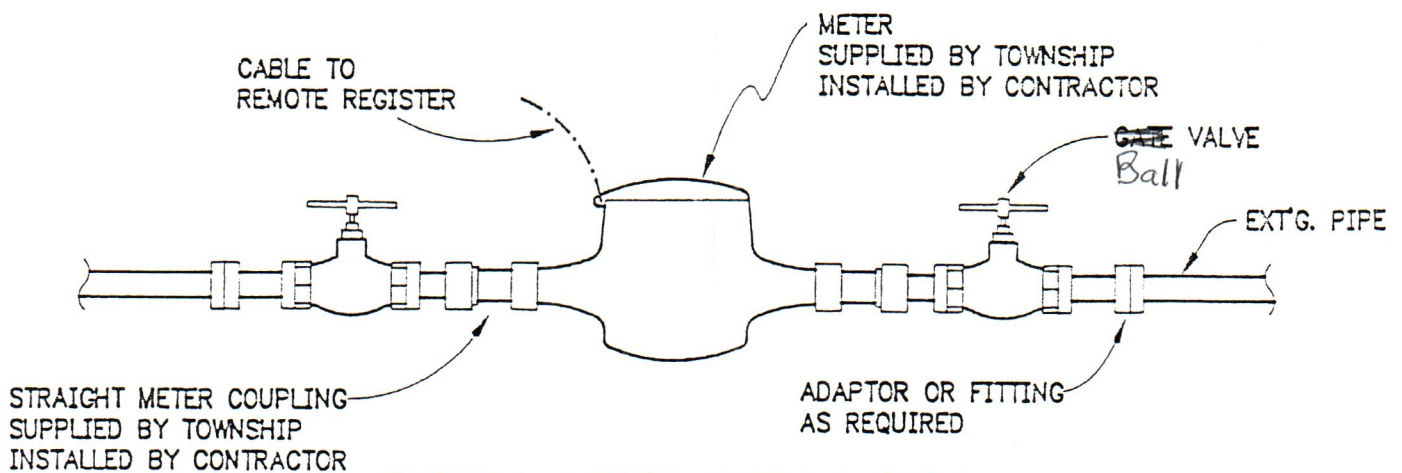

TYPICAL METER INSTALLATION
STRAIGHT SETTING

METER INSTALLATION SCHEMATICS

BEAR CREEK TOWNSHIP